Aeron® Window Control System - Synchronised Actuator Wiring Detail

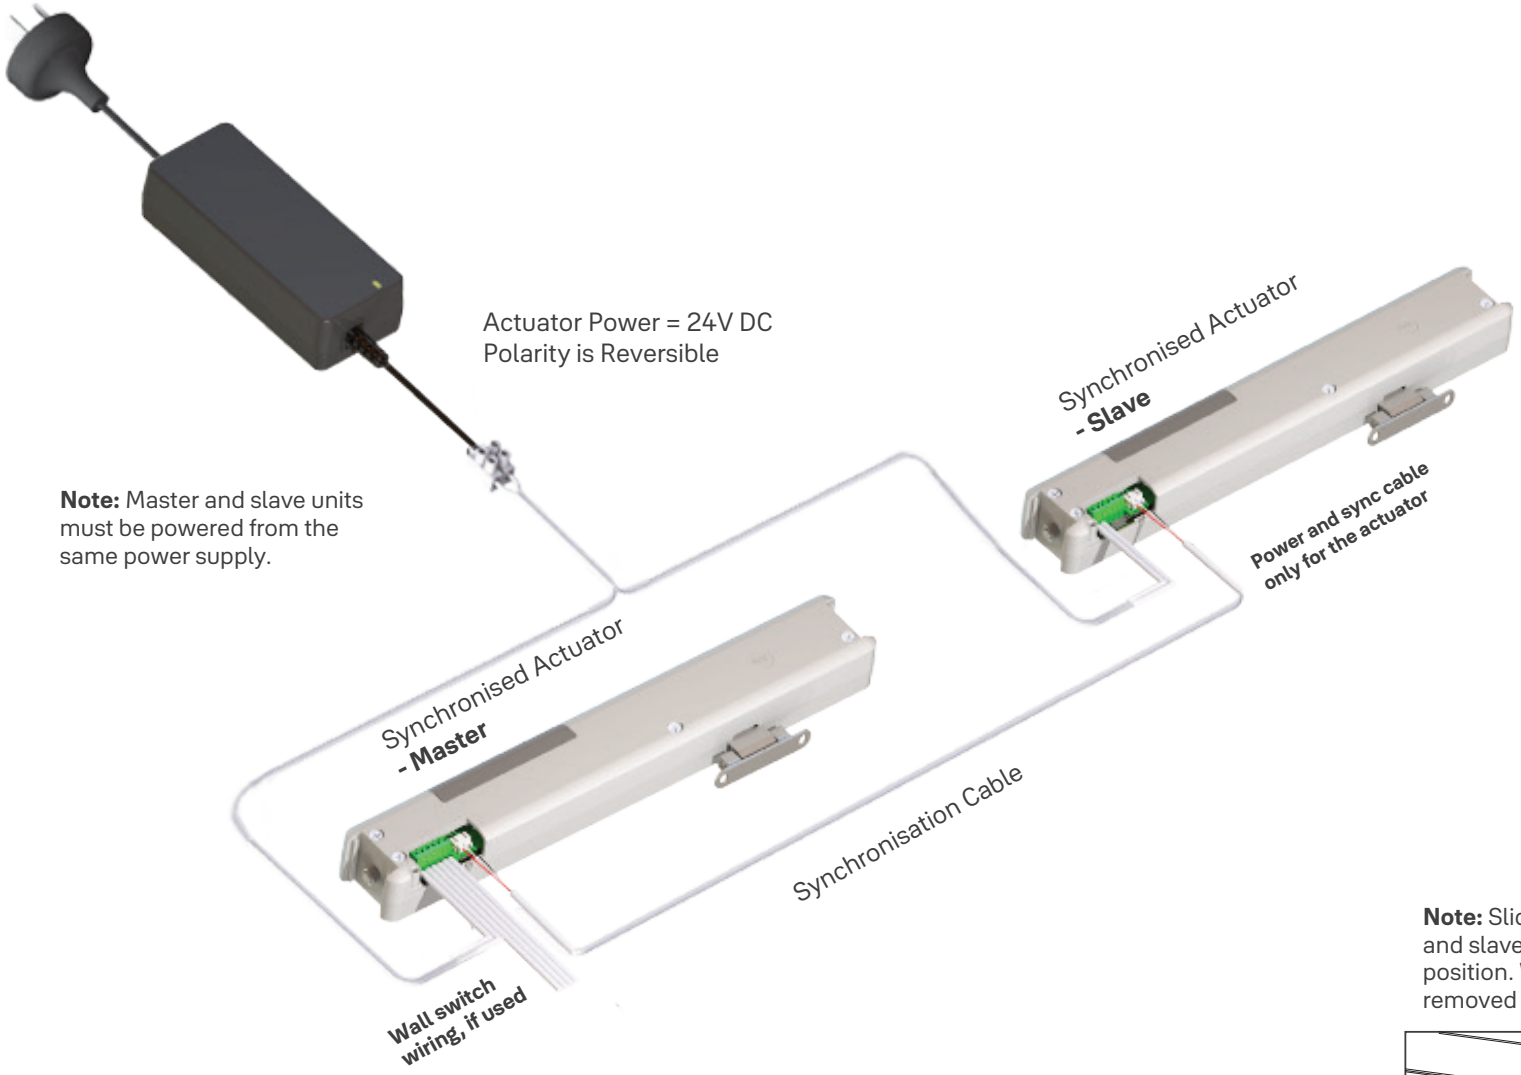

Note: Master and slave units must be powered from the same power supply.

Note: Slide switch position on both master and slave units need to be at the same position. Wireless module must be removed from slave unit.

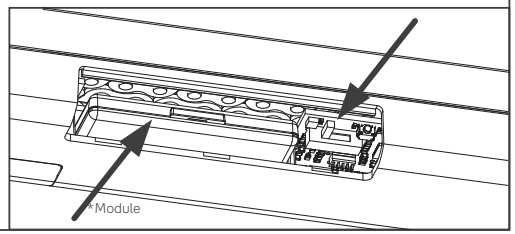

050295_0723